

Lessons Learned in ICFMP Project for Verification and Validation of Computer Models for Nuclear Plant Fire Safety Analysis

Dr. Monideep K. Dey



Presented at the ISO TC 92 SC-4, WG 7 Meeting, Paris, France,
April 3, 2011

Objective of Presentation

- Present “lessons learned” in conduct of “blind” validation exercises in International Collaborative Fire Model Project (ICFMP)
- Recommend “blind” V&V procedures be included in ISO standard
- Capabilities & limitations of fire models derived in ICFMP presented elsewhere


International Collaborative Fire Model Project (ICFMP)

- Conducted 1999-2008 by USNRC
- I Led project from 1999 to 2006
- Evaluate fire models for NPP applications through 5 benchmark exercises (BE)
 - Code to Code
 - Code to experimental data
 - Simple to challenging scenarios


ICFMP Cont'd



- Five countries participated, typically 7 organizations exercised fire models
 - Germany – GRS, iBMB (COCOSYS, FDS, CFX, CFAST)
 - France – IRSN, EdF, CTICM (FLAMME-S, MAGIC)
 - UK – BRE (JASMINE, CFAST)
 - USA – NRC, NIST (CFAST, FDS, FDTs)
 - Assigned as guest researcher at NIST
 - Analyst for NRC
- 10 organizations participated in peer review
- 12 international workshops over 10 years
- 5 ICFMP benchmark reports and summary report

ICFMP Benchmark Exercise No. 1 – Cable Tray Fires

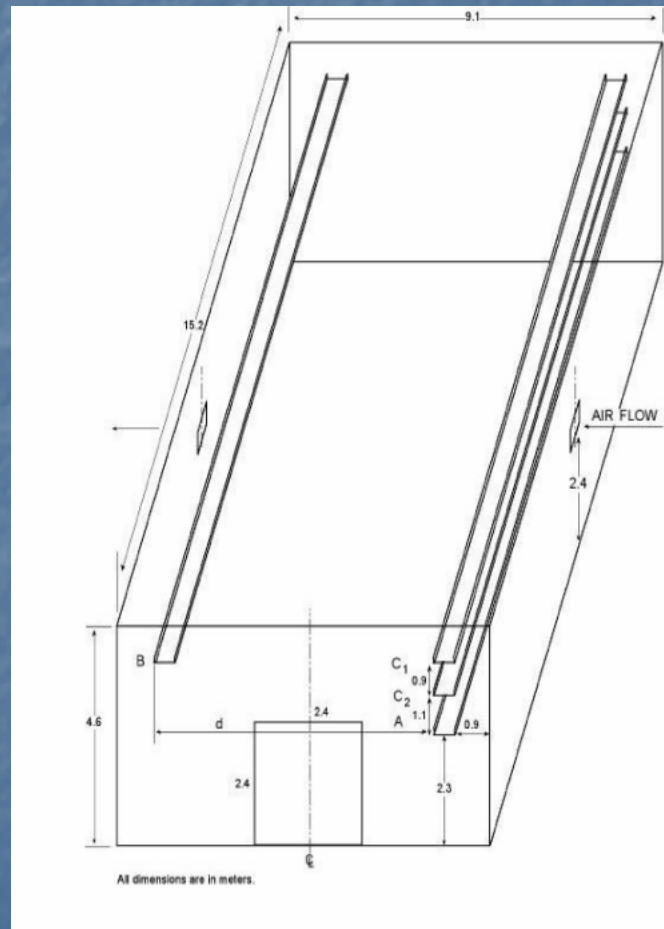


ICFMP Benchmark Exercise No. 2 – Pool Fires in Large Halls

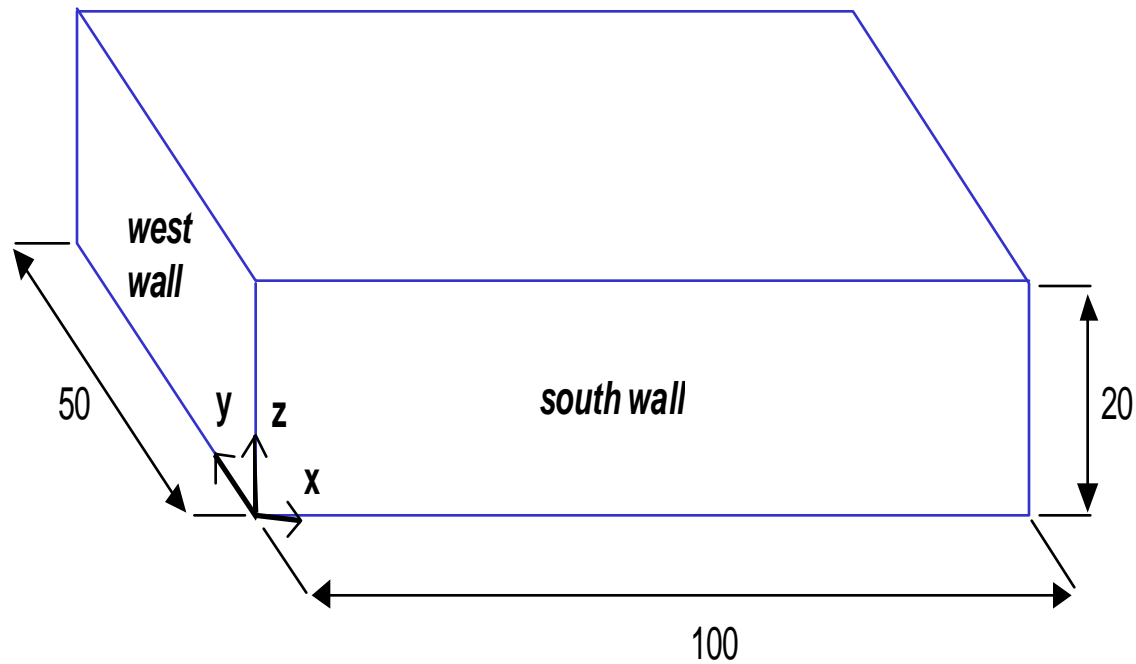

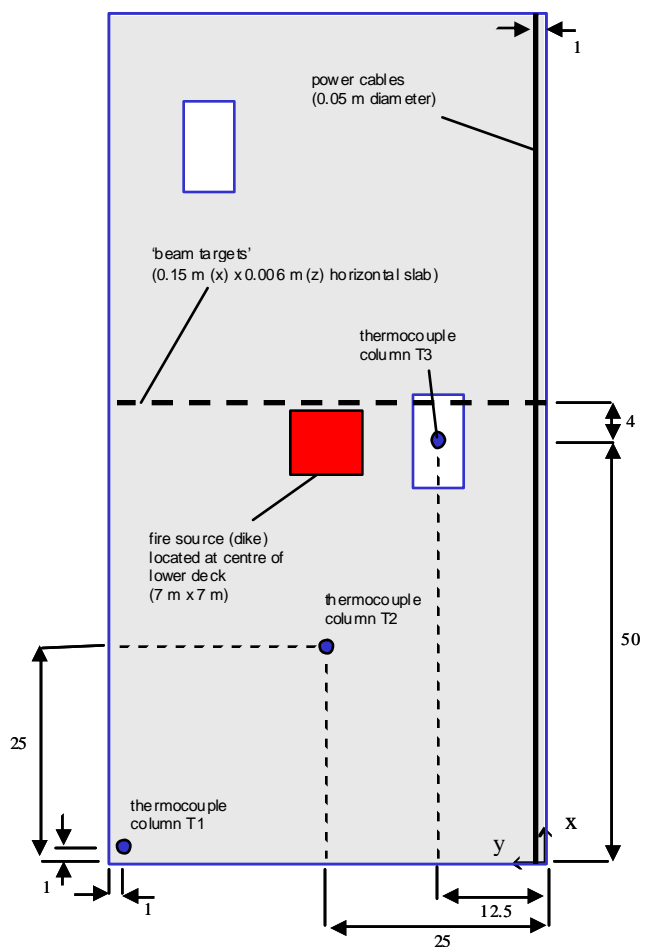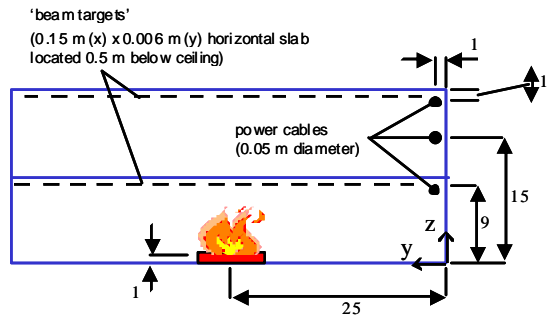

ICFMP Benchmark Exercise No. 3 – Full Scale Compartment Fire Tests

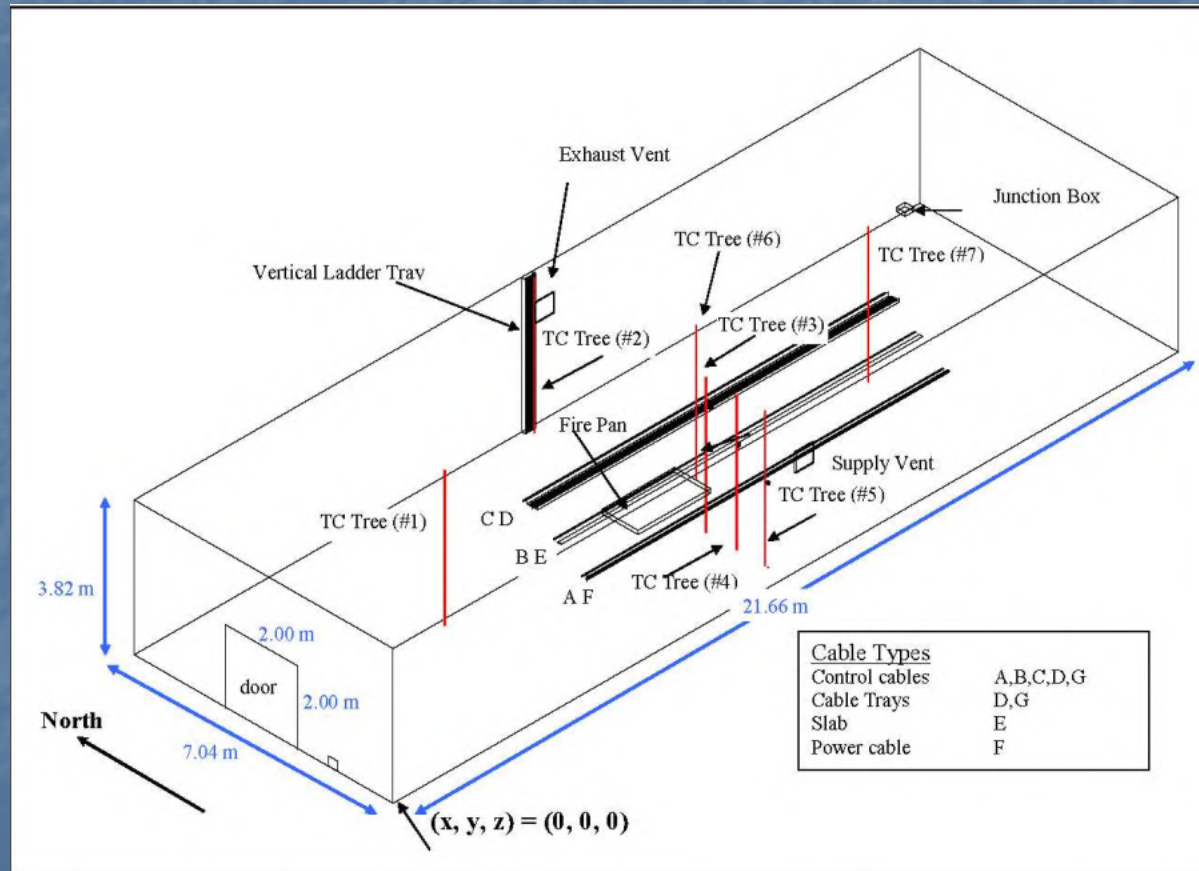






Copyright
Deytec, Inc., 2011

ISO TC 92 SC 4 WG 7 Meeting
April 3, 2011


ICFMP Benchmark Exercise – No. 4

Large Fire Experiments

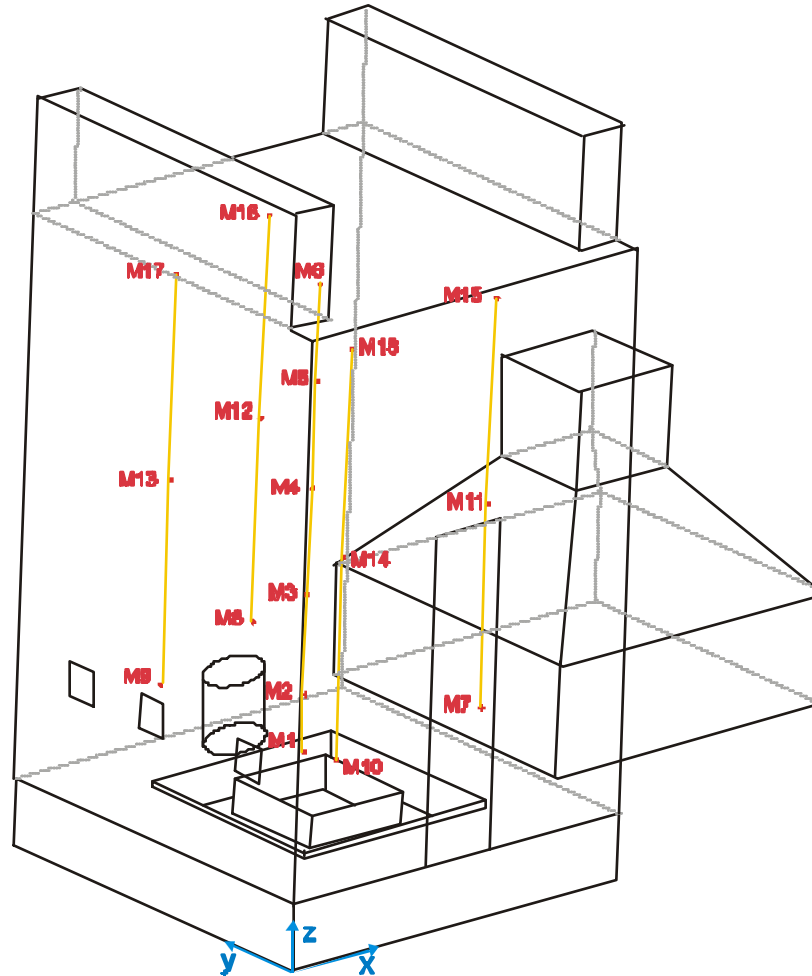



ICFMP Benchmark Exercise No. 5 – Pool Fires in a Trench

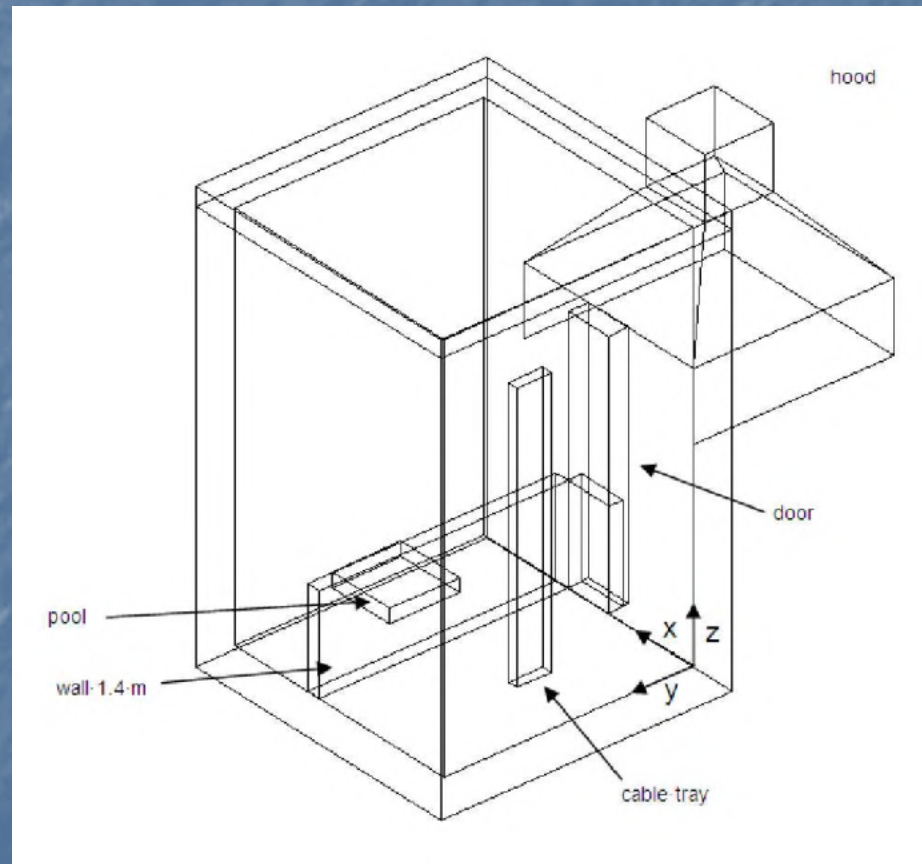



V&V Process to Determine Fire Model Predictive Errors

- ICFMP established to conduct “blind” benchmark exercises
- Need credibility of V&V process by determining true predictive errors

“Blind” vs “Open” Predictions

- In a priori (aka *blind*) modeler has no access to experimental data
- In a posteriori (aka *open*) modeler has access to the experimental data and measurements of predicted parameters
- Comparison of *blind vs open* calculations
 - Dalmarnock fire test project
 - Possible to match measured parameters by adjusting model input data

Bias in V&V Process

- Natural bias exists in *open* predictions
- Most fire model validations conducted a posteriori (*open*)
- Extent of bias presently unknown & currently being researched
- Need true predictive errors to establish safety margins
- “Real World” Fires


V&V Procedures in ICFMP

- Recognized need to conduct *blind* validations to determine “true” predictive errors essential to establishing safety factors
- Minimize debate about input parameter values through detailed specifications of the benchmark exercises

Challenges of *Blind* V&V Overcome in ICFMP

- Replication of experiments
- Conduct of tests according to test plan
- Uncertainty in model input data
- Sensitivity & uncertainty analysis
- Need to establish “optimal” prediction

BE # 3 Replicate Tests 2 & 8 Compartment Temperature Tree 7-1

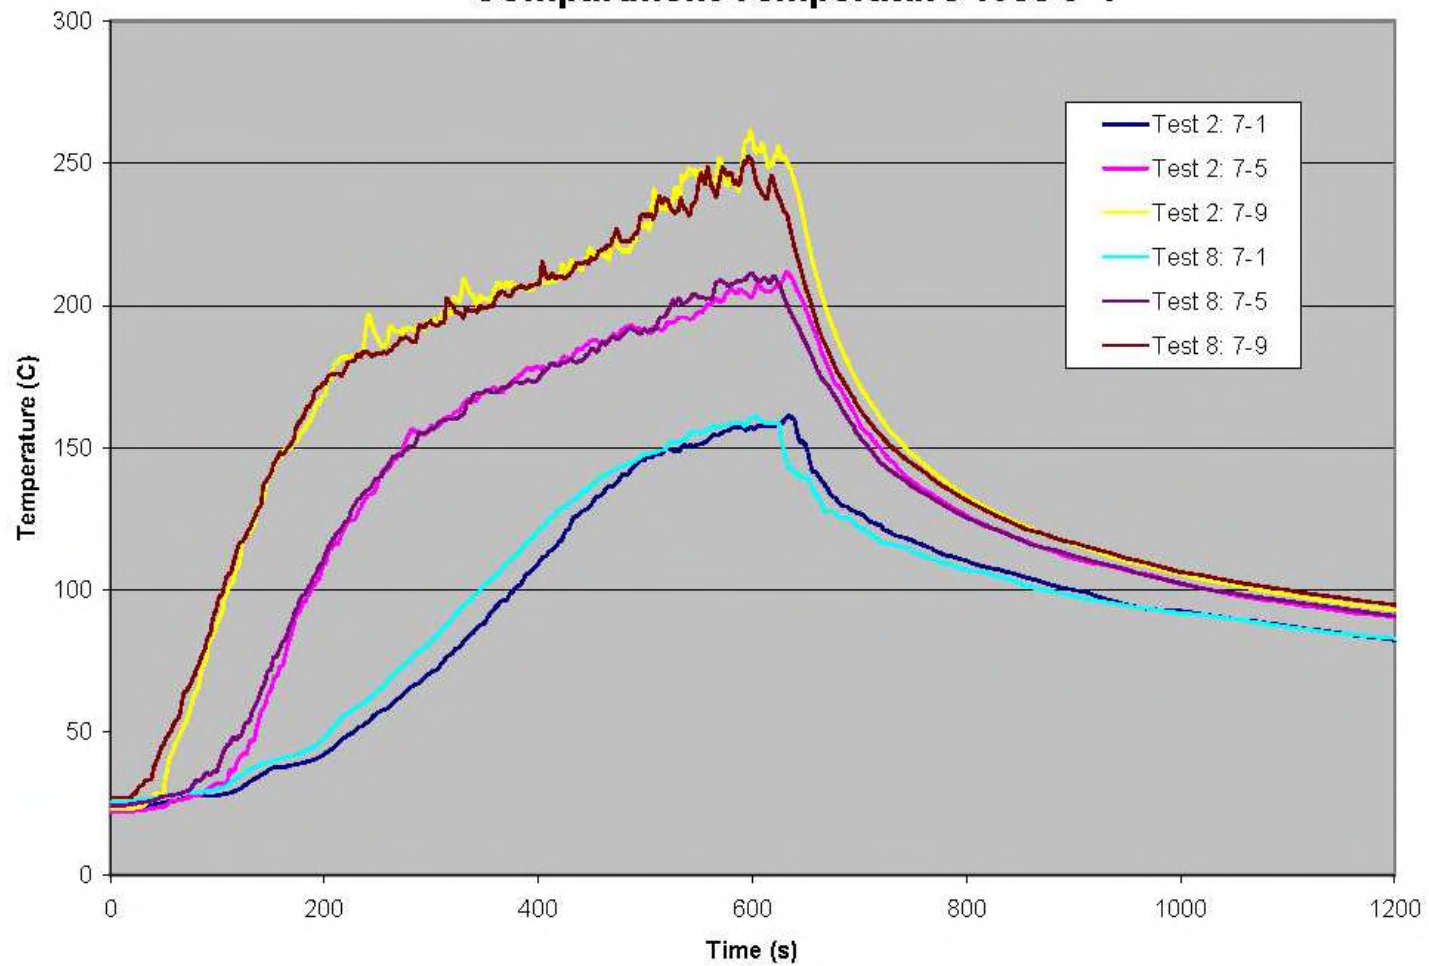

Issues Identified in V&V Process

- Lack of agreement among participants on measurements & data needed as input to fire models being exercised;
- Lack of established formal procedure for submission & collection of *blind* calculations from participants.

Parameter Issues

- Heat Release Rate (HRR)
- Radiative Fraction
- Thermal Parameters of Compartment Boundary

Heat Release Rate (HRR)

- Knowledge of combustion process/need to input parameter to models
- Predominantly determines magnitude of fire effects
- Major source of uncertainty

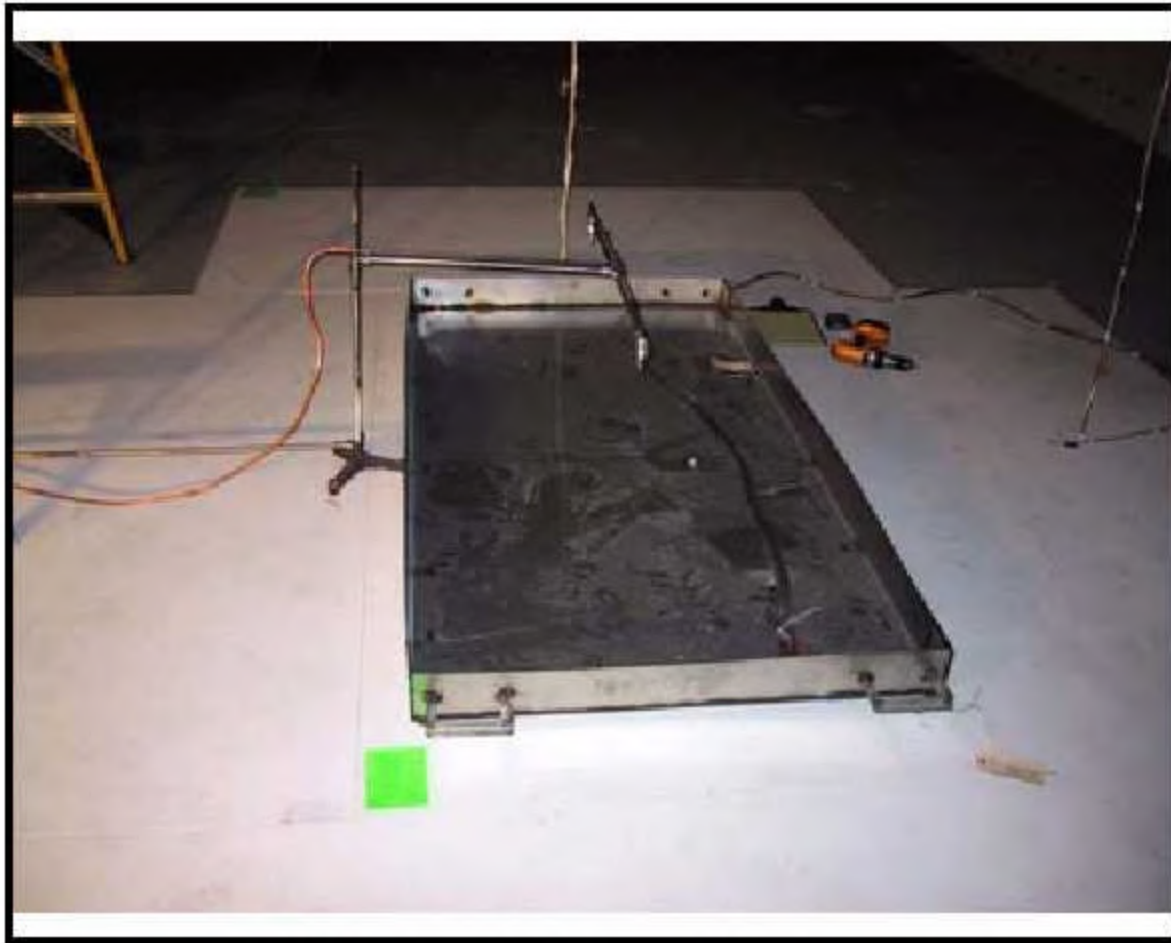


Figure 2.12 Fuel Pan with Spray Nozzle



Figure 3.3 Hot Gas Layer in Test 3

Table 3-1 Evolution of Heat Release Rate for Benchmark Exercise No. 3, Test 3

<u>Release Date</u>	<u>July 2,</u> <u>2003</u> ^{**}	<u>July 21,</u> <u>2003</u>	<u>September 9,</u> <u>2003</u>	<u>April 4,</u> <u>2004</u>	<u>June 2005</u>
HRR - from fuel flow	1050 [*]	1050	1150	1150	1150
HRR - from calorimetry	1150	1260	1260	1260	1190

^{*} HRR specified in kW

^{**} Prior to release of experimental data

Radiative Fraction

- Radiative fraction of heat from fire must also be input to models
- Not measured for BE # 2, values of 0.4 used by some analysts (0.2 specified)
- Considerable effort made in BE # 3 to measure parameter but still disputed & adjusted by some analysts
- Similar issues in BE # 4 & 5

Table 3-2 Combustion Properties of the Test Fuels for Benchmark Exercise No. 3

Fuel	Hc (kJ/g) ¹	Combustion efficiency ²	Radiative fraction ³	Soot yield ²	CO yield ²	CO ₂ yield ²
Heptanes	45.0	1.0 ± 0.06	0.35 ± 0.08	0.0149 ± .0033	<0.006	3.03 ± 0.37
Toluene	40.3	0.76 ± 0.05	0.36 ± 0.08	0.194 ± 0.062	0.070 ± 0.016	2.53 ± 0.31

1. Report of Test Results, Galbraith Labs, March 2003. The expanded uncertainty is not reported but is typically 5 %.

2. The Global Combustion Behavior of 1 MW to 3 MW Hydrocarbon Spray Fires Burning in an Open Environment ([Hamins, 2003d](#)).

3. Hamins, Kashiwagi and Buch in Fire Resistance of Industrial Fluids (Eds.: Totten and Reichel), ASTM STP 1284, 1996

Thermal Properties of Compartment Boundary

- Not measured & controversial for Benchmark Exercise No. 2
 - Properties adjusted to reduce thermal inertia by 50 % by some analysts
- Considerable effort made in BE # 3 to measure parameters but still disputed & adjusted by some analysts

Table 3-6 Material and Optical Properties of Marinite.

T (°C)	K (W/m K)	α (m ² /s) [*]	c _p (J/kg K)	ϵ **
23	0.111	2.13 x 10 ⁻⁷	778	0.74±0.04
50	0.114	2.15 x 10 ⁻⁷	795	
100	0.126	2.17x 10 ⁻⁷	871	
200	0.140	2.17 x 10 ⁻⁷	965	
300	0.153	2.18 x 10 ⁻⁷	1047	
400	0.160	2.21 x 10 ⁻⁷	1082	
500	0.175	2.26x 10 ⁻⁷	1160	
600	0.190	2.36x 10 ⁻⁷	1205	
650	0.198	2.42 x 10 ⁻⁷	1223	

* Taylor, R.E., Groot, H., and Ferrier, J., *Thermophysical Properties of PVC, PE and Marinite*, Report TPRL 2958, April 2003.

** Hanssen, L., Report of Optical Test Data, March 2003.

Procedure Issues in ICFMP V&V

- Submission & collection of *blind* calculations were not conducted per an established formal procedure or standard
- Informal due to collegial nature of collaborative project & lack of standard
- Participants were permitted to categorize their calculations as *blind* or *open*.

Conclusion of *Blind* V&V

- Participants modified model input data based on their determination of the appropriate values
- Assumed this would still constitute as a *blind* calculation
- Some confusion on definition of “*blind*” calculation
- *Blind & Open* calculations could not be distinguished

Conclusion of *Blind V&V* – Cont'd

- Predictions by analysts differed:
 - Up to 45 % difference when same model used
 - Up to 40 % difference when models of same sophistication used
- ICFMP exercises failed as *blind* exercises

Recommendations for Fire Model V&V Standard

- Establish consensus on measurement methods for parameters needed as input to fire models
- Develop consensus on values for parameters input to fire models
- Establish procedure for conducting & ensuring that *blind* calculations are used to establish predictive model errors & safety margins
- Examine and include “third party validation” as an option for establishing true model errors

Conclusion

- V&V process in ICFMP project was very beneficial in many respects
- Benchmark exercises allowed different models to be analyzed & compared against each another & experimental data for a wide range of NPP fire scenarios
- Capabilities & limitations derived from such comparisons